

Pedestrian and Bike Bridges on the Wildlife and Conservation Corridor

Jekyll Island, GA


Original Deadline for Questions Due-----July 6th, 2026 @5:00 p.m. ET


Revised Deadline for Questions Due -----August 7th, 2026 @5:00 p.m. ET

Original Deadline for Proposals Due-----July 27th, 2026 @3:00 p.m. ET


Revised Deadline for Proposals Due -----August 17th, 2026 @3:00 p.m. ET

Higher Resolution Drawings Attached

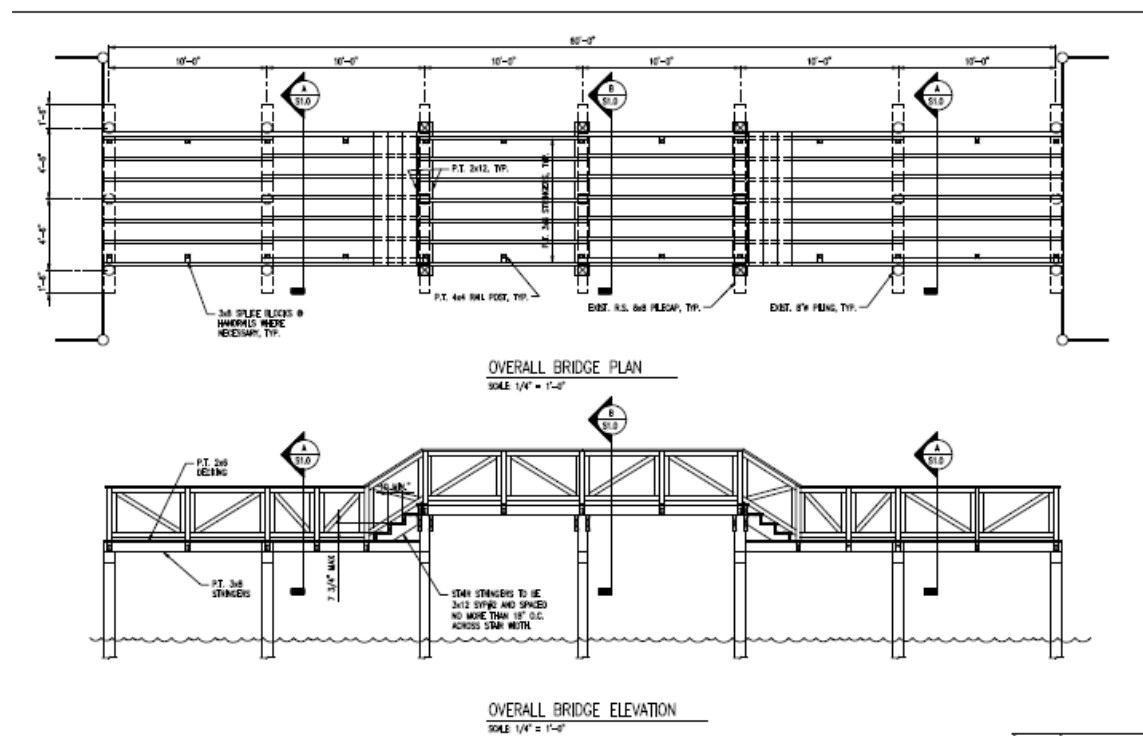


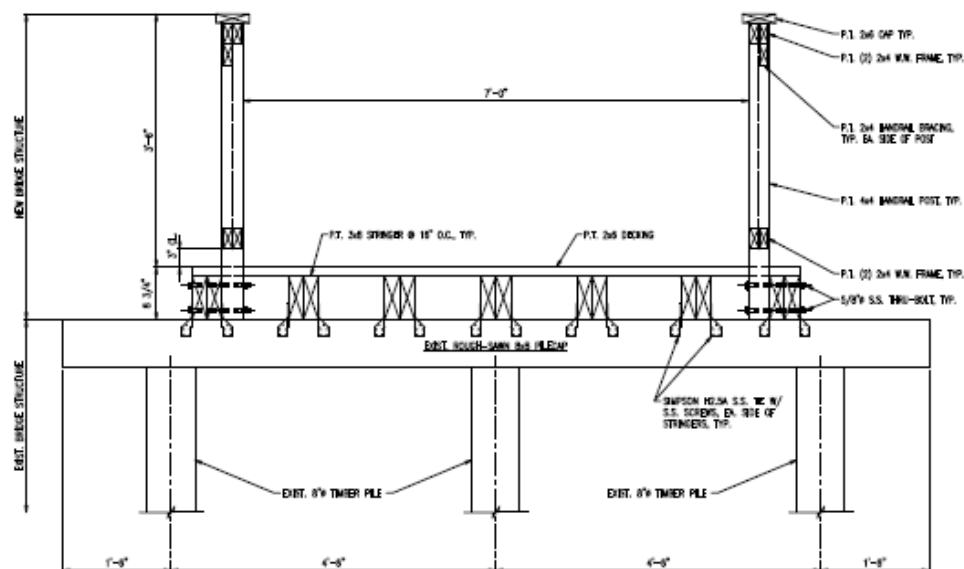

A
S1.0
TYPICAL LOWER WALKWAY SECTION
SCALE: 1" = 1'-0"

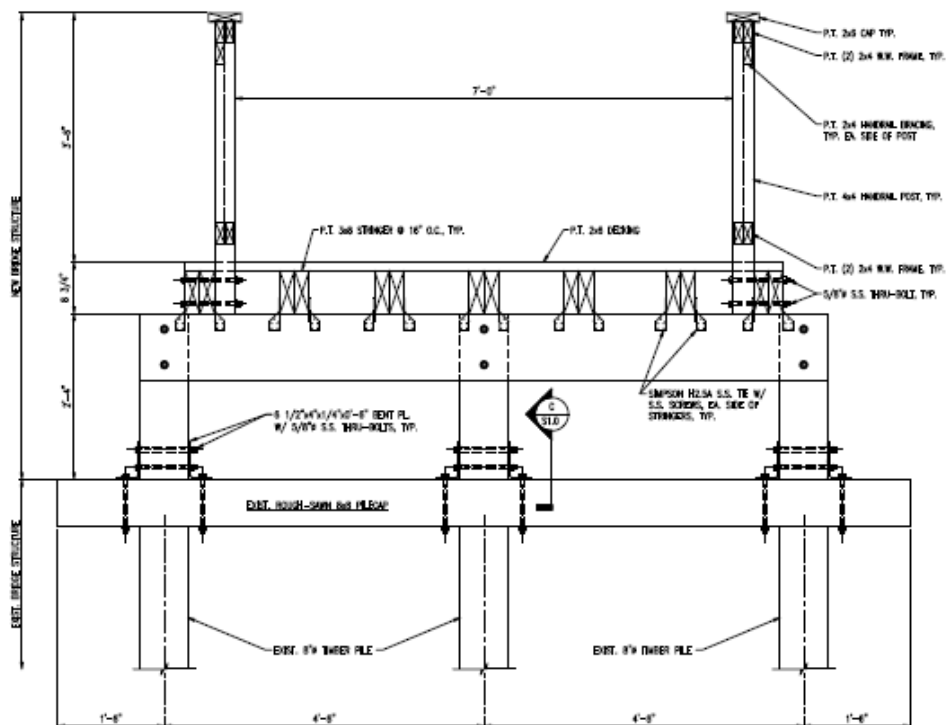

B
S1.0
TYPICAL UPPER WALKWAY SECTION
SCALE: 1" = 1'-0"

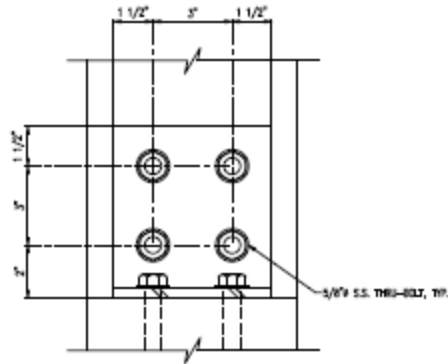

TYPICAL LOWER WALKWAY SECTION

SCALE: 1" = 1'-0"

WOOD FRAMING NOTES:

1. WOOD FRAMING SHALL BE INSTALLED PER INTERNATIONAL BUILDING CODE, 2004 EDITION WITH LATEST GA AMENDMENTS, & NATIONAL DESIGN SPECIFICATION, LATEST EDITION.
2. DESIGN LIVE LOAD = 100 PSF
3. ALL LUMBER USED IN CONSTRUCTION TO BE SOUTHERN YELLOW PINE NO. 2 OR BETTER, UNLESS NOTED OTHERWISE.
4. ALL LUMBER SHALL BE PRESURE TREATED IN ACCORDANCE WITH AWPA STANDARD U1, USING THE FOLLOWING CRITERIA:
 - 4.1. HANDRAILS & DECKING: AWPA U30S; ACQ
 - 4.2. STRINGERS, PILE CAPS & OTHER COMPONENTS (EXCEPT PILING): AWPA U40S; ACQ
 - 4.3. TIMBER FRAMING: AWPA U40S; ACQ
5. ALL LUMBER SHALL BE MARKED GRADE AND IDENTIFIED BY GRADE AND TREATMENT MARK OF A REGISTERED ORGANIZATION CERTIFIED BY THE AMERICAN LUMBER STANDARDS COMMITTEE, AND SHALL BE KILN DRIED AFTER TREATMENT (KDHT).
6. ALL FASTENERS (BOLTS, NAILS, SCREWS OR SPIKES) ARE TO BE 316 STAINLESS STEEL AND SHALL BE COMPATIBLE WITH SELECTED CONNECTORS. DO NOT MIX DISSIMILAR METALS.
7. FRAMING CONNECTORS AND HURRICANE TIES ARE TO BE STAINLESS STEEL.

STAIR AND RAILING NOTES

1. MINIMUM TREAD DEPTH SHALL BE 10 INCHES. TREAD DEPTH SHALL BE MEASURED HORIZONTALLY BETWEEN THE PLANES OF THE FURGEST PROJECTIONS OF ADJACENT TREADS AND AT A RIGHT ANGLE TO THE TREAD LEADING EDGE. THE GREATEST TREAD DEPTH WITHIN A FLIGHT OF STAIRS SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8 INCH.
2. MAXIMUM RISE HEIGHT SHALL BE 7 3/4 INCHES. RISE HEIGHT SHALL BE MEASURED VERTICALLY BETWEEN THE LEADING EDGES OF ADJACENT TREADS. THE GREATEST RISE HEIGHT WITHIN ANY FLIGHT OF STAIRS SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8 INCH.
3. PROVIDE FLOOR OR LANDING AT THE TOP AND BOTTOM OF EACH STAIRWAY. THE MINIMUM WIDTH PERPENDICULAR TO THE DIRECTION OF TRAVEL SHALL BE NO LESS THAN THE WIDTH OF THE FLIGHT SERVED. THE MINIMUM LENGTH IN DIRECTION OF TRAVEL SHALL BE NOT LESS THAN 36 INCHES.
4. CONTINUOUS CHAMFEREDS SHALL BE PLACED ALONG ALL UNPROTECTED EDGES OF WALKING SURFACES, FLOORS, STAIRS OR RAMPS LOCATED MORE THAN 30 INCHES ABOVE ADJACENT FLOOR OR GRADE LEVEL.

PI-Tech

PI-TECH, INC.
STRUCTURAL ENGINEERING
CONSULTANTS
GA C.O.A. #PE000300
FL C.O.A. #00068

P.O. BOX 702
BRUNSWICK, GA 31521
(912) 228-8363
(912) 743-5940
www.pi-techinc.com



ANDREW T. FORRESTER, P.E.
GA LICENSE #PE000300

REVISION
